© 2011 Westwood Professional Services, Inc.

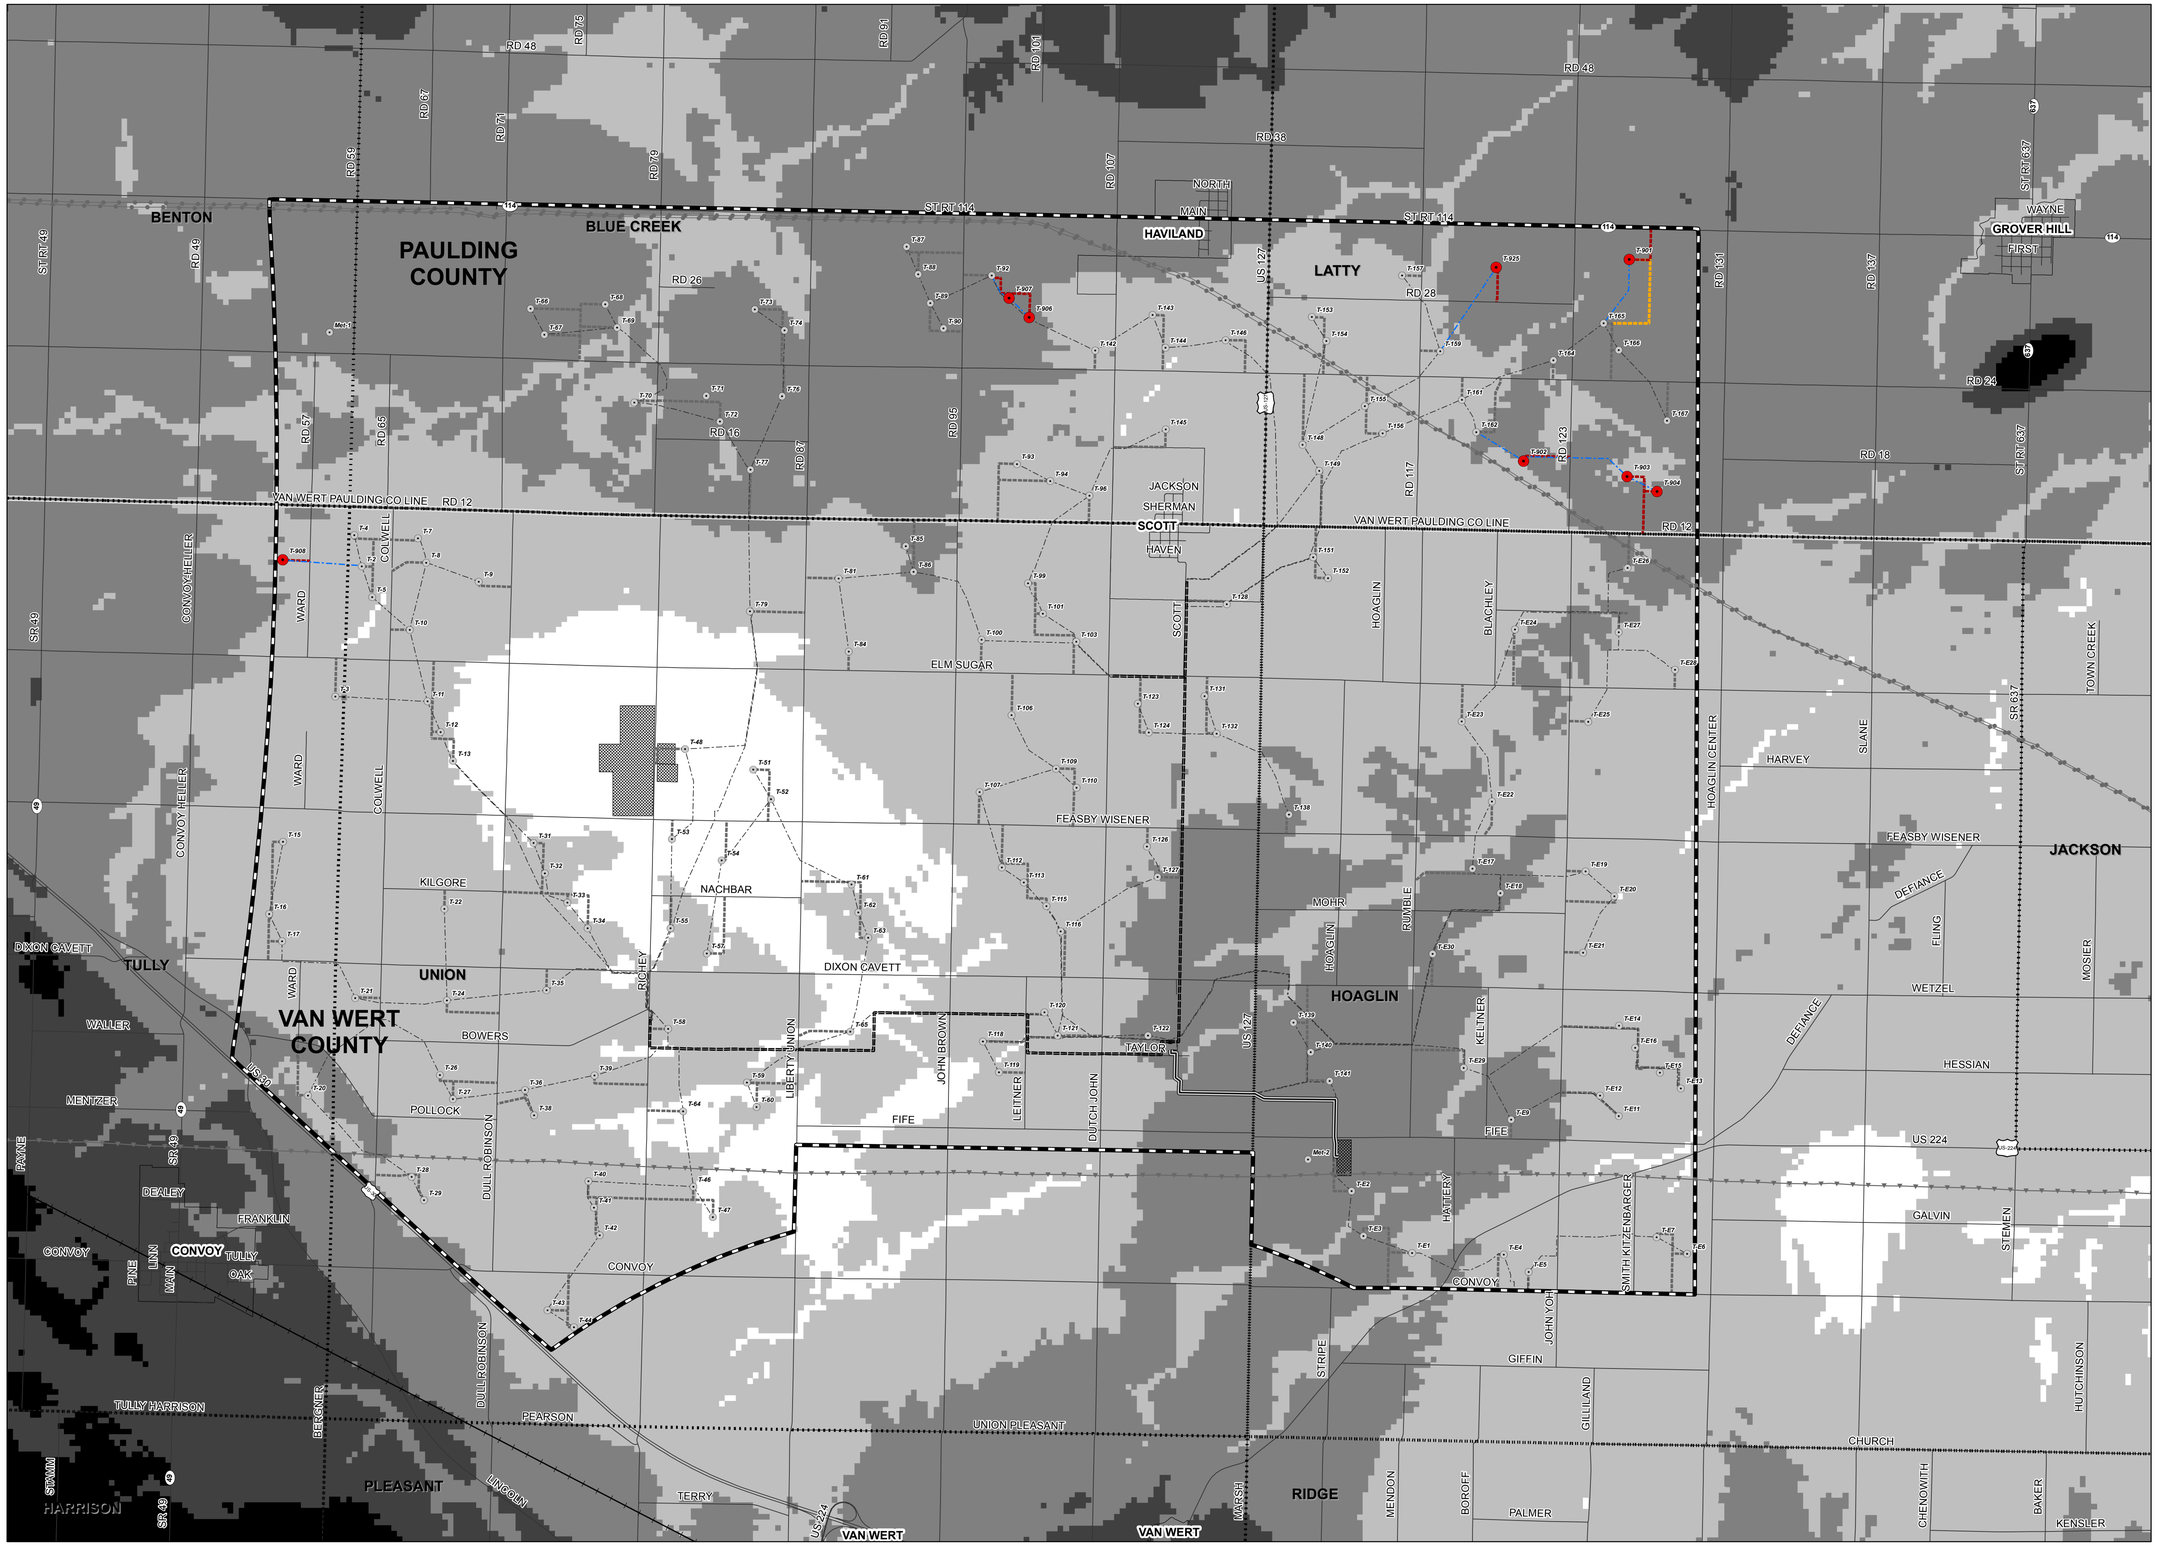

Legend

- Project Boundary
- County Boundary
- City Boundary
- Township Boundary
- Railroad
- O&M Building, Substation, Laydown Area, Switchyard, Construction Parking
- Original Turbine Location
- Amended Turbine Location
- Existing 345 kV Transmission Line
- Existing 138 kV Transmission Line
- Proposed 115 kV Transmission Line
- Proposed 34.5 kV Transmission Line
- Proposed Underground Collection
- Amended Proposed Underground Collection
- Existing Roadway
- Proposed Access Road
- Amended Proposed Access Road
- Alternative Amended Proposed Access Road

Glacial Drift Thickness (feet)

- 0 - 10
- 11 - 20
- 21 - 30
- 31 - 40
- 41 - 50

Data Source(s):
Westwood (2010)
Transmission from State of Ohio Public Utilities Commission (2002)
State, County, and City Boundaries,Townships, Heliports, Airports, and Major Roads from Ohio gov DOT (downloaded 2010) and ESRI Data and Maps (2008)
Railroad from Federal Railroad Administration (2010)
Roads from U.S. Department of Commerce, U.S. Census Bureau, Geography Division (2009).
Drift Thickness from Ohio Geological Survey (2003)

N

0 0.5 Miles

IBERDROLA RENEWABLES

FIGURE A05-4
Blue Creek Wind Farm Area
Glacial Drift Thickness Map

Panel 1 of 1

Created: March 21, 2011

Westwood Professional Services, Inc.
5887 Blazer Parkway
Dublin, Ohio, 43017-3348
PHONE 952-906-1620
FAX 952-906-1822
TOLL FREE 1-888-937-5150
www.westwoodps.com

Map Document: (P:\2010\1300\gis\2010\1300gis03D_F5_4.mxd)
3/29/2011 9:28:32 PM